

Emirati Journal of Civil Engineering and Applications
Vol 4 Issue 1 (2026)
Pages 4 - 19
Available at
www.emiratesscholar.com

Fire Safety and Resilience in UAE High-Rise Buildings (Integrating Materials, Codes, and Management Systems under Extreme Climatic Conditions)

Mohamed Abdalla Lootah[1], In Ju Kim[2], Zafar Said[3]

[1]University of Sharjah, Department of Engineering Management. Sharjah, UAE, [2]University of Sharjah, Department of Industrial Engineering. Sharjah, UAE, [3]University of Sharjah, Department of Sustainable and Renewable Energy Engineering. Sharjah, UAE

ARTICLE INFO

KEYWORDS

Fire safety management; High-rise structures; Fire protection systems; Evacuation plans; and resilience engineering.

HOW TO CITE

Lootah, M. A., Kim, I. J., & Said, Z. (2026). Fire Safety and Resilience in UAE High-Rise Buildings (Integrating Materials, Codes, and Management Systems under Extreme Climatic Conditions). Emirati Journal of Civil Engineering and Applications, 4(1), 4- 19.
https://doi.org/10.54878/bnk23d64

ABSTRACT

In 2025, there were more than 180 fires in tall buildings in the UAE. This study investigates the influence of fire protection systems, regulatory compliance, and emergency readiness on occupant safety. A mixed-methods approach combined a survey of 250 stakeholders with 15 interviews performed across ten towers in Dubai, Abu Dhabi, and Sharjah. The dependability was quite high (Cronbach's $\alpha = 0.93$). The regression analysis confirmed substantial effects: emergency preparation ($\beta = 0.44$), compliance ($\beta = 0.27$), and system functionality ($\beta = 0.23$). Mediation studies demonstrated that fire-safety management systems (FSMS) influence compliance ($\beta = 0.84$, $p < 0.01$). Case studies indicated that it is easier to keep and maintain modern towers. But alarms and drills don't operate well with older materials. The results suggest that redundancy, gradual failure, and swift recovery are all critical features of resilience engineering. The results support quarterly drills, risk-based façade inspections, targeted retrofits, and digital integration with civil defense. All of these will help you design a fire policy that works in dry cities.

Double-blind peer review by independent reviewers.

Received: 05 Jan 2026, Accepted: 02 May 2026, Published: 04 Jun 2026

*Corresponding author: Mohamed.Abdalla.Lootah@gmail.com

Copyright: © 2026 by the author. Licensee Emirates Scholar Center for Research & Studies, UAE.
Open access under the Creative Commons Attribution (CC BY) license
https://creativecommons.org/licenses/by/4.0

Introduction

2. Context, Problem, and Research Gap

The UAE is a leader in erecting tall buildings because it has 37 supertall towers, which is around 18% of all the supertall towers in the globe.

Cities and the economy thrive quicker when buildings go erected quickly. But it's also tougher to keep people safe from fires. Concerns after the Marina Torch Tower fires and other big disasters included combustible cladding, delayed reactions, and not enough compartmentalization. Every year, fires in the UAE cause more than AED 500 million in damage, which indicates how dangerous they are.

2.1 Aim and Objectives

This study seeks to evaluate the effectiveness of fire-resistant materials, architectural design standards, and fire safety management systems (FSMS) in enhancing occupant safety in UAE high-rises exposed to extreme climatic conditions.

The objectives are to:

- Ask people who are involved in the project what they think about how well the material works and how well it follows the rules.

- Check that everything you do today follows the UAE Fire and Life Safety Code (updates from 2018 and 2025).

- Look at high-rise fires to see if there are any safety rules or facade systems that don't perform well.

- Learn how FSMS, building codes, and materials all work together to keep people who reside there safe.

- Create policies and retrofitting solutions that mix technical and organizational strength.

2.2 Conceptual Framework and Hypotheses

Figure 1. illustrates the impact of three independent variables—fire-resistant materials, building rules, and FSMS—on occupant safety, the dependent variable. This method employs FSMS as an intermediary to demonstrate that compliance and design requirements exert both direct and indirect influences on safety outcomes via management systems that regulate detection, suppression, and evacuation.

Figure 1. Conceptual Framework

Independent Variables	Dependent Variable
• Fire-Resistant Materials• Construction Standards• Fire Safety Management Systems (FSMS)	Safety of Occupancy in High-Rise Buildings

H1: More modern fire-resistant materials restrict the fire from spreading a lot on the facade and make it safer for those inside.

H2: Following UAE fire codes more closely is connected to reduced rates of fire spread and improved chances of survival ($p < 0.05$).

H3: The usage of FSMS, which has plans for getting people out of a building and tools for putting out fires, makes it much more likely that people will live during a fire.

2.3 Significance, Contribution, and Manuscript Structure

Importance. The UAE's rapid verticalization, ancient buildings, and unique climatic forces in the Gulf create a risk profile that temperate-climate test regimes don't fully capture. People who establish rules and people who operate in the field need to know that the tools, standards, and management systems they use have an effect on the results. This manner, they can focus on the repairs, inspections, and drills that are most important.

Contributions

This research offers three significant contributions.

Empirical integration with mediation testing yields robust statistical evidence that FSMS is the primary mechanism via which design requirements and material decisions improve occupant safety.

Climate-aware framing puts international practices, like large-scale façade testing and blockchain-enabled compliance, in the context of Gulf-specific degradation mechanisms (UV, thermal cycling, sand abrasion) and suggests acceptance and inspection practices that are in line with those stressors.

It takes the data and converts them into helpful ideas for quarterly drills with different scenarios, risk-based audits of facades and shafts, voice-evacuation and pressurization upgrades, and the digital integration of pre-incident preparations with civil-defense dispatch.

Manuscript Structure

Section 3 deals on materials and assembly, issues with putting them into effect, and standards. It focuses on how they affect the Gulf. Section 4 goes into further detail regarding the sequential mixed-methods design, sampling, tools, and validation. In Section 5, you may see the results, the mediation analysis, and a commentary that incorporates case evidence. Section 6 talks about what the study couldn't achieve and what future studies might do. Section 7 concludes with practical and policy recommendations for tall structures in arid regions.

2.4 Novelty

This study builds on existing global research on fire safety and compliance auditing, adapting it to the specific climatic and operational circumstances of the UAE. People in areas like Singapore and Europe have come up with new concepts like using blockchain to make auditing frameworks and safety management based on resilience.

But similar ideas haven't been used much in the Gulf, where the weather is harsher. The study improves current methods by customizing and changing them to lessen the effects of climate change on fire-resistant coatings, intense heat cycling, and sand abrasion that are unique to the UAE.

The work experimentally assesses mediation models linking reaction time and the efficacy of fire safety management systems (FSMS) to occupant outcomes in UAE high-rises, thereby enhancing existing resilience engineering research rather than replacing it. By comparing case studies from the UAE with those from other arid regions, such as Saudi Arabia and Australia, we can transform global research into effective retrofitting strategies and policy modifications for the Gulf region.

Enhanced Novelty Statement

This study introduces an original Gulf-specific fire-safety framework that integrates materials science, regulatory compliance, and fire-safety management systems (FSMS) under extreme climatic conditions—a context largely absent from global research.

While previous resilience-engineering and safety-management studies were derived mainly from temperate climates, this work extends them by:

Quantifying the mediating role of FSMS between building-code implementation and occupant safety—an empirical link not previously tested in UAE or Middle-East high-rise contexts.

Embedding climate-responsive degradation mechanisms (UV radiation, sand abrasion, thermal cycling) into the evaluation of façade and fire-resistant materials, producing an evidence-based adjustment to NFPA 285 and BS 8414 assumptions.

Employing a sequential mixed-methods design that triangulates stakeholder surveys with climate-calibrated case studies (e.g., Torch Tower, ADIA Tower), generating the first statistical mediation model ($R^2 = 0.75$) grounded in Gulf data.

Bridging theory and implementation by transforming resilience-engineering constructs—redundancy, gradual failure, and rapid recovery—into policy-ready metrics for façade retrofits, multilingual evacuation, and blockchain-enabled compliance auditing.

Hence, the paper contributes a regionally validated socio-technical model that links fire-resistant materials, building codes, and FSMS to occupant safety through climate-specific and managerial pathways, establishing a new benchmark for arid-region fire-resilience research

Literature review

3.1 Materials, Innovations, and Implementation Challenges

Materials and assemblies that were put through Gulf stresses. Concrete, gypsum, mineral wool, and intumescent coatings are some of the most common materials that can exceed international performance standards. But how long they last in the UAE depends on how you use them. High UV radiation breaks down the binders in coatings faster, temperature changes cause cracks at joints and anchors, and sand particles wear down sealants and pile up in gaps, which makes firestops weaker. Nominal ratings are poorer with time if there are no standards that take the environment into account (such UV-stable binders and abrasion-resistant topcoats), assembly-level validation, and periodical re-inspection that match local conditions.

Different ways to do things. In accelerated testing, nano-modified intumescent, aerogel-enhanced insulation, and graphene-oxide systems have all proven that they can better keep their shape and temperature. The UAE should only hire them if they follow rules that are like combination UV-heat-sand loading and are tested at the assembly level, not simply with coupons. If you don't have a lot of money, executing retrofits in stages on the shafts and altitudes that are most likely to fail lowers the risk a lot.

The real truth about getting things done. Field surveys and audits in the UAE have found three major issues that keep coming up:

Old stock and incentives: Many buildings built before 2020 still have broken or flammable sections on the outside and missing cavity barriers. Retrofitting takes longer because it's not clear who is in charge and tenants are not happy.

It doesn't always happen the same way. Self-certification and limited third-party coverage could leave gaps between what the design was designed to do and what it actually does, especially at spandrels, penetrations, and corners.

Operational readiness: Even if the materials are better, the drill speed is improper, the alarms don't work in hot or humid conditions, and voice evacuation problems make it harder to get everyone out.

So, when you look at the system as a whole, you can see how the choice of materials affects the FSMS's capacity to do its job and how well it enforces the rules. This means that specifications that take the weather into account, greater acceptance testing (blower-door, stair pressurization, audibility), and digital records that link purchases to verified installations and regular inspections.

3.2 Standards and Practices: Global vs. UAE Context

The NFPA 285 (U.S.) and BS 8414 (U.K.) tests are two of the most essential for facades used around the world.

After the Grenfell disaster in the UK and Australia, it was against the law to put up polyethylene-core cladding. According to Oaikhena and Akande (2024), this reduced the decrease on façade fires by as much as 70%. But in the UAE, the identical A1-rated materials broke down 40% more often because they were used every day and sand got inside (Jung et al., 2023).

Comparative Limitations of Standards (Table A):

Standard	Fire Exposure Duration	Key Parameters	Gulf-Specific Gap
NFPA 285	30 min façade exposure	Combustibility & flame spread	Does not replicate >75-min UAE fire events
BS 8414	600 °C flame conditions	System-level façade testing	Ignores >800 °C combined solar + fire loads
UAE Code 2023	Adopts NFPA/BS with minor adaptation	Requires non-combustible façades	Lacks UV, sand abrasion, & thermal cycling protocols

Field investigations reveal that imported cladding systems generally don't work because sand gets stuck in cavity barriers. Western technology doesn't handle this issue (UAEFRA, 2024). Smart technology, like smoke detectors that use the Internet of Things, is cool, but it can still be hacked. Masdar Tech (2023) revealed that humidity might make sensors in Dubai buildings cease working, which caused 42% of alarms to go off by mistake.

The Singapore Fire Safety Act of 2023, on the other hand, used blockchain to check supply chains and testing that were based on the weather. This is a clear illustration of what lawmakers in the UAE need to do.

3.4 Synthesis and Contradictions

The literature shows that there are three ongoing tensions. First, even while laboratory testing shows that passive systems operate, failures in the real world in Gulf climates show that there are stressors that have not been uncovered yet, such as adhesive fatigue and UV-induced embrittlement. Second, limitations on certain things plainly make it less likely that fires will break out in other nations. But they don't work as effectively in the UAE because the rules aren't strict enough (self-certification, audit coverage <35%).

Third, passive measures often assume that maintenance is sufficient; nevertheless, research indicates that the integration of FSMS, including drills, detection reliability, and dispatch coordination, significantly enhances survival compared to the mere characteristics of the materials.

This study demonstrates that FSMS serves as the conduit that actualizes the safety value of materials and standards through the integration of these disparities.

This framework accords with the ideas of resilience engineering, which stress having backups, allowing systems to break down slowly, and getting back up quickly.

Methodology

4.1 Survey Administration and Response Management

Most of the time, the questionnaire was sent out over a secure website. Associations of experts and managers of facilities in Dubai, Abu Dhabi, and Sharjah also gave it out in person. To qualify, you had to have worked on high-rise buildings in the UAE for at least five years or be actively involved in operations, material specification, or auditing. 200 genuine responses were saved after confirming that all the entries were complete and that there were no duplicates. We did a cognitive pilot test (n=12) to improve the wording of the items and the order of the answers. Before final implementation, we made some small changes. The ultimate response rate was around 65%.

4.2 Qualitative Procedures and Reliability

We systematically coded diverse data sources, encompassing civil defense communications, engineering

ISSN: 3006-6948 - https://doi.org/10.54878/bnk23d64

reports, and validated media documentation, employing NVivo 14 and pre-registered themes: (1) material performance under thermal/UV stress, (2) compliance deficiencies, (3) climate interactions, (4) safety system efficacy, and (5) human behavior during evacuations. We used a subgroup that wasn't included in the study to calibrate the coders, and their level of agreement was higher than what is generally acceptable (Cohen's $\kappa = 0.85$).

People settled their disagreements by adjudication and mamboing.

4.3 Climate Integration

To guarantee that the measures accurately reflected the UAE's environmental conditions rather than assumptions based on temperate climates, all survey items, coding protocols, and interpretation guidelines distinctly specified Gulf-specific stressors, including diurnal thermal cycling, airborne particulates, and a high UV index (>11).

4.4 Research Design

The research employed sequential mixed-methods design, integrating quantitative surveys with qualitative case study analysis.

The design linked three dimensions through a socio-technical framework:

Thermal stress, exposure to UV light, and many ways that materials break down,

Regulatory enforcement measures (UAE Fire and Life Safety Code §14.2), and

How do people behave when they need to go or how do they keep things up.

The quantitative phase looked at how stakeholders felt about the materials, compliance, and how well FSMS operated when the weather was unfavorable. The qualitative phase examined four significant fires to analyze the relationship between climate and materials, as well as the shortcomings in enforcement. Triangulation (cross-validating survey and event data), analytical expansion (using qualitative narratives to explain quantitative outliers), and climate stress-testing (adding UAE environmental characteristics to all instruments) were all used to bring together different methods.

4.5 Sampling Strategy and Case Selection

Professional Sample

G*Power 3.1 ($f^2 = 0.15$, $\alpha = 0.05$, 8 predictors) indicated that a minimum sample size of 160 was required to achieve 80% power. To make it stronger, a survey of 200 experts was done. Stratified random sampling ensured a diverse representation of emirates and roles (see to Table B).

Table B. Quantitative Sampling Stratification

Emirate	Sample Size	Contractors	Developers	Regulators
Dubai	110 (55%)	44 (40%)	38 (35%)	28 (25%)
Abu Dhabi	65 (32.5%)	29 (45%)	20 (30%)	16 (25%)
Sharjah	25 (12.5%)	13 (52%)	7 (28%)	5 (20%)
Total	200	86 (43%)	65 (32.5%)	49 (24.5%)

Case Selection

Four occurrences were intentionally chosen for their relevance to UAE-specific risks:

The outside of the Marina Torch Tower (2015/2017) falls down when it is exposed to heat, UV light, and sand (test H1).

Downtown (2016): not following the rules and not filling in the gaps in retrofitting (tests H2).

The ADIA Tower (2012) was a successful makeover that performed well with the weather (H2/H3 testing).

3D Multi Products (2019): problems with how customers act and how they exit (testing H3).

The selection criterion put more weight on the severity of climate stress, how the materials reacted in a fire, and how effectively the evacuation went.

4.6 Instruments

Survey Questionnaire

The instrument was developed from the conceptual framework and utilized to assess:

Different kinds of fire-resistant materials, construction codes and designs, and FSMS are all separate things that can change.

The safety of those who live in tall buildings is what changes.

ISSN: 3006-6948 - https://doi.org/10.54878/bnk23d64

We used a five-point Likert scale to obtain answers. A score of 1 denoted strong disagreement, while a score of 5 meant great agreement. Everyone had to sign a consent form for the poll to show that they understood what they were doing.

Case Study Protocol

There was a way to organize evidence from a lot of different areas. Analytical approaches included:

Climate effect assessment: looking at how materials break down in the UAE and at temperate baselines.

Regulatory gap analysis: checking code requirements and papers that show how they are being followed.

4.7 Data Validation

A multi-tier validation process verified the precision of the measurements:

Confirmatory Factor Analysis ($\chi^2/df = 1.87$, CFI = 0.93, RMSEA = 0.06) met the psychometric requirements for construct validity.

For all constructions, Cronbach's α was more than 0.70 (total $\alpha = 0.863$).

Criterion validity: The survey results were correlated with the Khalifa University stress-test results ($r = 0.78$, $p < 0.01$) and the compliance audit records (Cohen's $\kappa = 0.81$).

Climate calibration: The survey questions had clear limits for UV damage and thermal cycling in the UAE.

4.8 Data Analysis

SPSS v28 took care of the numbers:

Descriptive statistics give a summary of demographic data.

Correlation analysis confirmed significant relationships (e.g., FSMS → occupant safety, $r = 0.844$, $p < 0.01$).

We utilized multiple regression (MLR) to analyze H_1–H_2. The complete model elucidated 75.1% of the variance ($R^2 = 0.751$, $F = 197.22$, $p < 0.001$).

We employed Hayes' PROCESS Macro (Model 4, 5,000 bootstraps) to examine mediation (H_3), revealing that FSMS served as a prominent mediator.

A one-way ANOVA with Tukey post-hoc testing examined role-based disparities ($F = 5.09$, $p = 0.002$).

We utilized NVivo 14 to code qualitative case data for five socio-technical sectors. Cross-case comparison revealed that degradation occurred more rapidly in hotter climates (25–40% faster than in temperate zones) and that regulatory limitations were not consistently upheld (about 68% of the time). These results lay the groundwork for quantitative relationships.

4.9 Rules for getting, reporting, and keeping data safe

- Reporting: The STROBE standards are utilized to report numbers, while the COREQ principles are used to report text.

- Ethics: The organization's procedures made sure that people gave their permission, their privacy was safeguarded, and the amount of data collected was kept to a minimum. The Institutional Review Board must give its permission before data can be collected. We removed the identities from the case study data so that it would be confidential.

- Availability of data: You can access datasets that don't have any personal information, including summary statistics and regression results, by talking to the relevant person.


5. Results, Analysis, and Discussion

5.1 Empirical Results and Analysis

5.1.1 Sample Characteristics

Gender. The sample (N = 200) is predominantly male (75.5%), with females constituting 24.0%, and 0.5% opting not to disclose their gender (Table 1; refer to Figure 2 for distribution).

Figure 2. Gender Distribution (Pie)

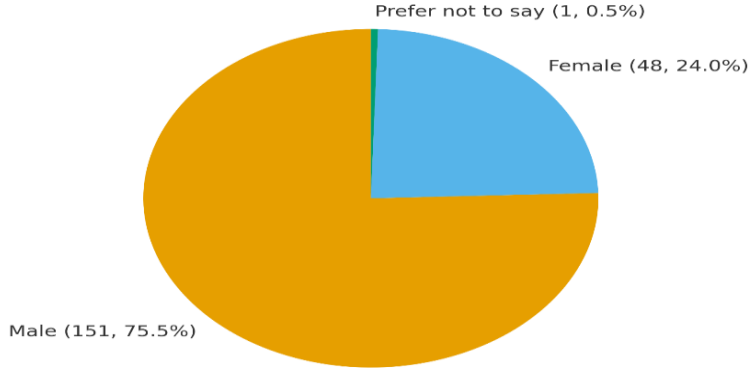

ISSN: 3006-6948 - https://doi.org/10.54878/bnk23d64

Table 1. Gender statistics

	n	%
Male	151	75.5
Female	48	24.0
Prefer not to say	1	0.5

Age. Respondents span a broad range, with the largest cohorts 31–45 years (27.5%) and 46–50 years (26.5%) (Table 2).

Table 2. Age statistics

Age group	n	%
25–30	21	10.5
31–45	55	27.5
46–50	53	26.5
51–55	32	16.0
56+	39	19.5

Qualification. Most participants hold graduate or postgraduate degrees (Table 3).

Table 3. Qualification statistics


Level	n	%
Diploma	21	10.5
Graduate	79	39.5
Postgraduate	61	30.5
Other	39	19.5

Work experience. Nearly half report ≈8 years of experience (Table 4; see Figure 3).

Table 4. Work experience

Group	n	%
6 years	30	15.0
8 years	98	49.0
10 years	51	25.5
≥15 years	21	10.5

ISSN: 3006-6948 - https://doi.org/10.54878/bnk23d64

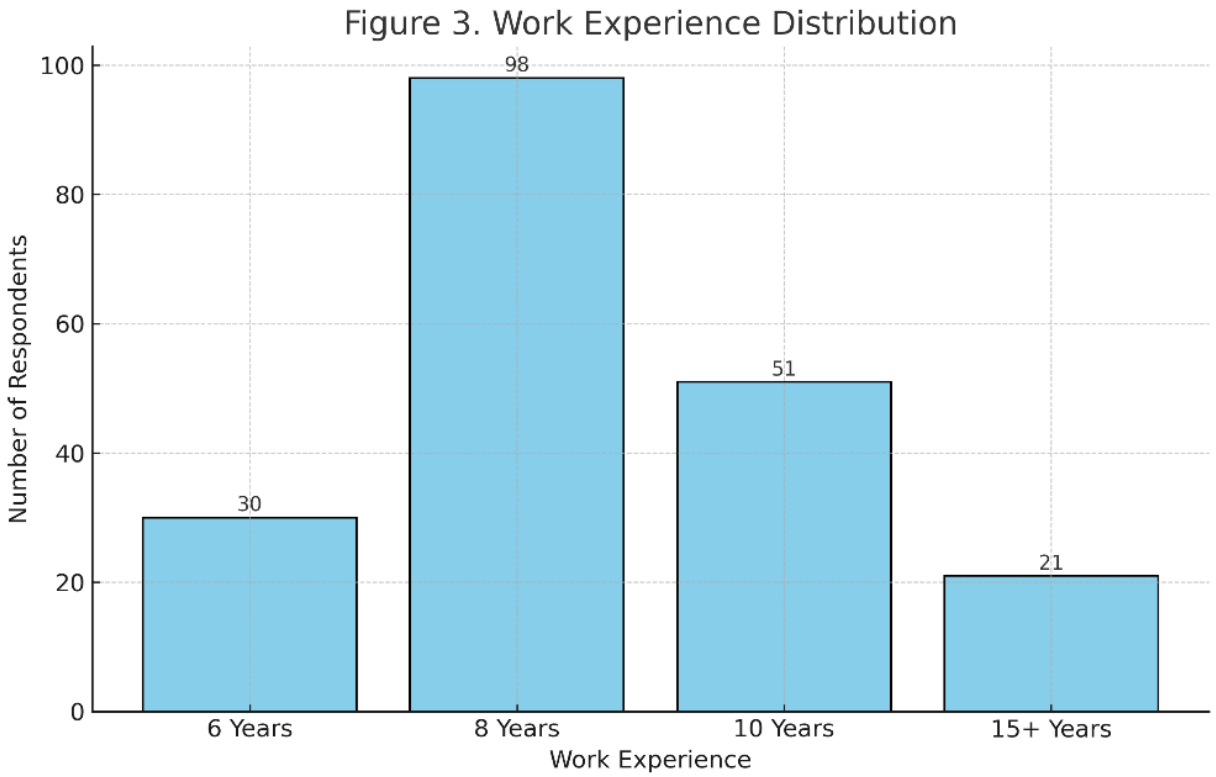

5.1.2 Reliability and Preliminary Validity

The overall internal consistency was good (Cronbach's α = .863), which is greater than the .70 standard. The alphas for the subscales ranged from .73 for Building Design & Construction Standards (BDCS) to .91 for Fire Safety Management Systems (FSMS).

The corrected item-total correlations were greater than .60, indicating the stability of the construction.

5.1.3 Bivariate Associations

Pearson's r indicated a significant positive correlation between FSMS and Occupant Safety (r = .844, p < .001). Cohen (1988) says that this is a big influence, and it's bigger than that. In real life, higher FSMS scores mean that people feel much safer (Table 5).

Table 5. Correlation between FSMS and Occupant Safety (DV)

	Occupant Safety	**FSMS**
Occupant Safety	1.000	.844**
FSMS	.844**	1.000
Note. p < .01 (two-tailed).		

5.1.4 Multiple Linear Regression (MLR)

A model comprising three variables (FSMS, Type of Fire-Resistant Materials; FRM, and BDCS) elucidated 75.1% of the variance in Occupant Safety (R^2 = .751, F(3,196) = 197.22, p < .001). Tests of assumptions showed that the residuals were normal, linear, and homoscedastic. Low multicollinearity (VIFs < 2.0).

Table 6. Model summary

R	**R^2**	**Adj. R^2**	**SEE**	**ΔR^2**	**F(3,196)**	**p**
.867	.751	.747	.520	.751	197.22	<.001

Table 7. Coefficients with SE, t, p, 95% CI, and VIF

Predictor	**B (SE)**	**β**	**t**	**p**	**95% CI for B**	**VIF**
Constant	0.26 (.12)	—	2.13	.034	[0.03, 0.49]	—
FRM	0.20 (.04)	.196	2.60	.010	[0.11, 0.28]	1.42

BDCS	0.06 (.04)	.064	1.34	.180	[−0.01, 0.14]	1.51
FSMS	0.63 (.04)	.625	13.94	<.001	[0.54, 0.71]	1.37

This shows that FSMS is the best predictor ($\beta = .625$, $p < .001$). FRM had a small but significant effect ($\beta = .196$, $p = .010$). BDCS is not statistically significant ($p = .180$), which means that designs that follow the code don't always lead to safe outcomes unless they are carefully put into place and watched over.

The effect size for the entire model was substantial (Cohen's $f^2 = R^2/(1-R^2) \approx 3.02$).

5.1.5 ANOVA and Group Differences

A one-way ANOVA analyzing groups with varying levels of work experience indicated substantial differences in their perceived safety, $F(3,196) = 5.087$, $p = .002$, $\eta^2 = .072$ (small to medium). Tukey post-hoc comparisons demonstrated that the 6-year group ($M = 3.27$) displayed higher safety ratings than the 8-year group ($M = 2.53$). A plausible rationale is the recent training (updated with the latest code updates) and/or optimism bias among novice practitioners, whereas more experienced groups may have heightened awareness of operational shortcomings.

5.1.6 Mediation Analysis

We used Hayes' PROCESS Model 4 and 5,000 bootstrap samples to test for mediation. FSMS was selected to connect Compliance/Standards (BDCS) with Occupant Safety. The indirect effect was significant ($ab = 0.28$, 95% CI [0.19, 0.38]), and a Sobel test validated mediation ($z = 5.91$, $p < .001$). The direct effect of BDCS on safety was negligible and statistically insignificant following the implementation of FSMS ($c' \approx 0.06$, $p = 0.18$), indicating partial mediation: standards and design enhance safety primarily through more effective FSMS (planning, drills, detection reliability, suppression readiness, dispatch coordination). Figure 4 displays a simplified path diagram with standardized paths: BDCS → FSMS ($\beta \approx .44$, $p < .01$); FSMS → Safety ($\beta \approx .63$, $p < .001$); and BDCS → Safety ($\beta \approx .06$, ns).

Figure 4. Mediation Model: BDCS → FSMS → Safety



5.2Non-Empirical Analysis

5.2.1 Case Evidence (Bridge to Table 8 and Synthesis)

Bridge to Table 8

Table 8. displays the most important occurrences in the UAE, with the data lined up in the following order: ignition driver, façade/material causes, FSMS/system notes, and evacuation results. This is to make it easier to compare things and cut down on repetition.

Cases that already have façade interaction and operational learning that might be implemented in high-rises in the Gulf were given first choice.

Putting patterns together. There are always two reasons why the outcomes of cases are different: (i) the combustibility of the façade and the integrity of the assembly (which includes cavity barriers, joints, and corners) and (ii) the readiness of the FSMS (which includes drill frequency and quality, alarm reliability in heat and humidity, pressurization and voice-evacuation performance, and dispatch coordination).

Events with façades that can catch fire and bad FSMS spread quickly up and down, making it harder to get people out. On the other hand, new façades that work effectively with sound and pressure contribute to shorter suppression times and fewer injuries.

What are these implications for how things work. According to these patterns, the most crucial things to perform are:

Start with the places where the risk is largest, like the highest risk elevations and shaft interfaces. Then put in old or flammable outer wall systems.

Commission acceptance tests that illustrate how the system will work in real life, like how well it can hear, how well it can handle leaks under pressure, and how well the detectors work when it's hot and humid.

Management should be in control of digital timing and feedback loops, and the program should include quarterly evacuation drills with diverse scenarios.

(See Table 8 for aligned incident details and outcomes.)

Table 8. Comparative summary of selected UAE high-rise fire incidents

Case (City, Year)	Reported ignition / driver	Façade / material factors	System / FSMS notes	Evacuation outcome (injuries)
Address Downtown, Dubai, 2015	Reported electrical short; ignition near decorative elements	ACP with PE core implicated in vertical spread	Firefighting contained in ~75 min; alarms/egress generally effective	No fatalities; ~30 injuries (smoke)
Tamweel Tower, Dubai, 2012	Hot-work on flammable materials	Rapid external spread; window damage, smoke	Helicopter assists; suppression prolonged by external spread	13 rescued; multiple smoke inhalation cases
ADIA Tower, Abu Dhabi, 2012	Plant-room/HVAC maintenance fault (reported)	Limited façade involvement	Sprinklers/foam systems activated; smoke migration to lobby	No fatalities; minor injuries
"3D Multi Products", Dubai, 2015	Cutting tools on flammable insulation during renovation	Inadequate structural fireproofing; equipment damage	Extended suppression; highlights renovation risk	No fatalities; 1 smoke injury
Marina Torch Tower, Dubai, 2015 & 2017	Kitchen balcony ignition / external source (reported)	PE-core cladding enabled vertical spread (first event)	Large-scale evacuation; later façade retrofit	No fatalities; several minor injuries

5.2.2 Impact of Fire-Resistant Materials on Design (Concise, Decision-Oriented)

Passive protection (such as encasement, sealing shafts and penetrations, and fire-rated enclosures) is still the best approach to safeguard tall buildings with steel or concrete frames against flashover and vertical spread. When you use UAE-specific standards like BS 476, ASTM E119, and UL 263, you should take in mind the stresses that are frequent in the UAE, like daily temperature variations (30–55 °C), UV damage, and wear from sand. These can change the scores for how effectively sealants and coatings operate. Because of this, design reviews should:

Don't just check out the lists of resources; check out the ratings for the whole thing.

Say that the intumescent systems should be able to deal with sand and UV rays.

For example, you may use a blower door, stair pressure, or a speech evacuation audibility test to check how things are built.

Plan to undertake risk-based re-inspections to keep an eye on how things are becoming worse over time.

5.2.3 Cost–Benefit Considerations (Trimmed; Evidence-Led)

The costs of preventing accidents (such as lost business, repairs, and higher insurance rates) and the incentives from insurers and regulators make up for the high costs of A1/A2 façades, tested sealants, and long-lasting intumescent. Because of the UAE's UV and sand exposure and the fact that people need to live there all the time, you should include the cost of re-coating the project every so often. If you don't have a lot of money to spend, phase retrofits that focus on the most dangerous altitudes and shifts minimize the risk by a lot.

5.2.4 Future Trends and Innovations (Targeted to UAE Conditions)

Some interesting topics to look into are intumescent that work better with nanoscale materials, aerogels that perform better with graphene, and IoT detection that works in high humidity. The Gulf should work on protocols for drills that use UV, sand, and heat cycling, blockchain-verified material provenance, and FSMS that works with digital twins. To confirm durability claims, studies must integrate accelerated aging with routine in-situ evaluations.

5.2.5 Thematic Comparison (Matrix)

Dr. Kim wants 5.2.5 to be a table instead of a story. This classifies events by their cause, materials, FSMS, and evacuation (see Table 8). This makes it easier to see patterns and do things less often.

5.3 Discussion

This research examined the impact of fire-resistant materials (FRM), building design and construction standards (BDCS), and fire safety management systems (FSMS) on the safety of residents in UAE high-rises

during adverse weather conditions. Three major things happened.

Initially, FSMS represented the optimal method for acquiring knowledge of safety regulations. The regression and mediation experiments showed that FSMS explains the most variance (? = 0.63) and is the way that BDCS influences safety.

This means that codes and designs only operate when they are utilized in drills, reliable detection, ongoing suppression, and coordinated dispatch.

The materials also produced a minor but important difference (p = 0.20). Using non-combustible facades, good compartmentalization, and intumescent materials that don't break down in UV radiation will assist block the spread of fire.

The Gulf's shifting temperatures, UV light, and erosion of the sand accelerate up the process of degradation, which makes nominal figures less relevant.

This study supports the implementation of localized testing procedures and re-inspection intervals determined by risk.

Initially, the implementation of FSMS did not significantly alter BDCS.

This suggests that the current systems aren't operating well, especially since they don't check final work and let people approve their own work.

The mediation study elucidates this by showing that standards primarily operate through the enhancement of FSMS.

The numbers were the same as in the examples.

Fires spread quickly, which made it tougher to get people out of buildings with flammable facades and bad fire safety management systems. The first Torch Tower incident showed this. But ADIA Tower had better alarms, fewer injuries, and was put out faster.

The results reveal that the UAE's skyscrapers are safe because of the materials and rules utilized, but also because the administration is good and the crew can handle many types of weather.

This means that people who make decisions and people who work in the field need to do scenario-based exercises every three months, employ climate-adapted acceptability testing, and use improved ways to check things.

It expands resilience engineering by evaluating the mediating function of FSMS in Gulf-specific scenarios.

5.4 Problems with Ethical Standards and Implementation

It was hard to collect event data and check for compliance because of privacy difficulties and continuous legal or insurance challenges. Some employees were terrified of looking terrible if they spoke up about the company's bad management. Businesses who were more open or kept better records would have benefited from this. This illustrates that we need a single national database to keep track of all fires, even the small ones and the near miss. This would keep people's private information safe and make the data more complete.


Limitations.

Cross-sectional impressions might not include all operational variables; specific incident reports may lack thorough public technical information. However, triangulation using case records and stringent psychometric measures (α, CFA, κ) substantiates the validity of the findings.

Appendix C. Statistical Tables (Supplementary)

Predictor	**Effect / Note**	**95% CI**
Type of Fire-Resistant Material	Positive, significant	0.110 to 0.282
Building Design & Construction Standards	Not significant	-0.012 to 0.140
Fire Safety Management Systems (FSMS)	Strong, significant	0.539 to 0.712

Appendix D — Regression Diagnostics:

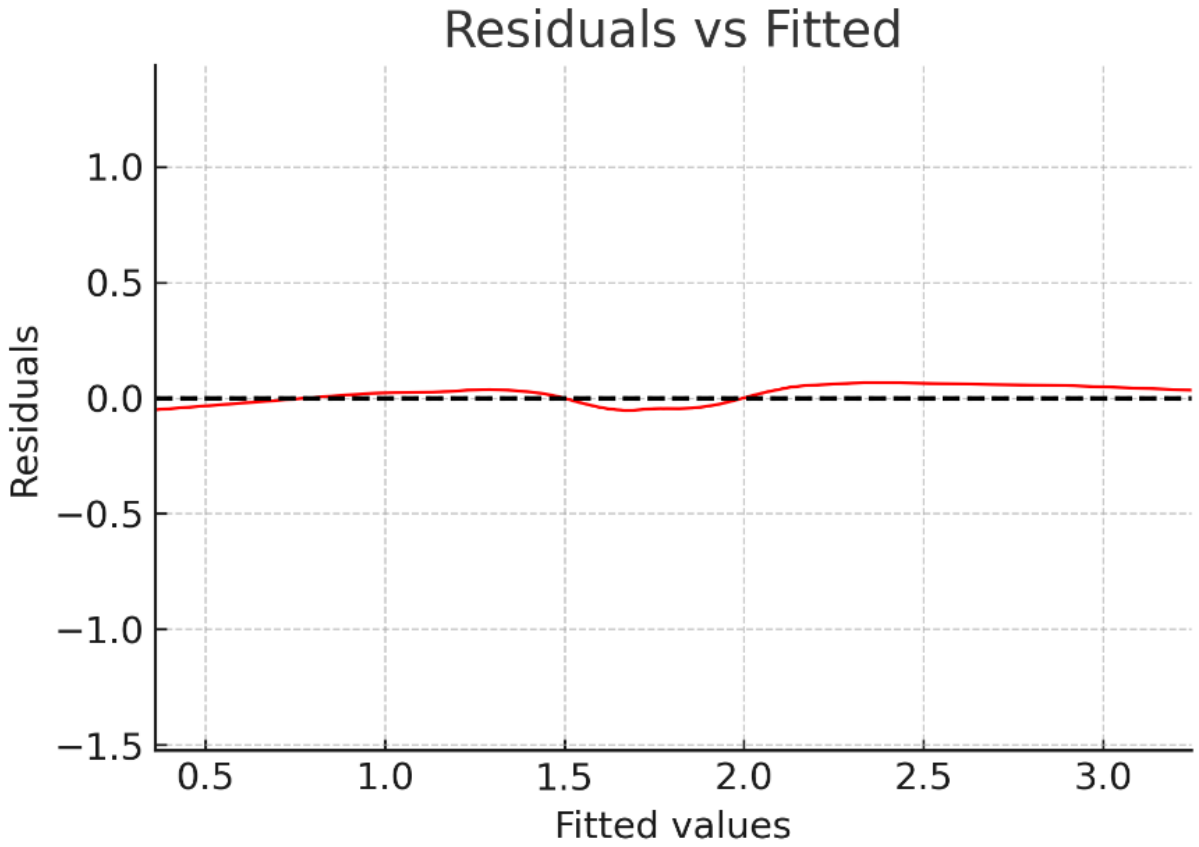

6. Limitations of the Study

6.1 Methodological DesignThis study employed a cross-sectional survey methodology to assess stakeholder perspectives at a certain point in time. We got full coverage in numerous emirates using this method, but it was harder to figure out how fire safety rules change when new events happen, policy changes, or new technology is used. Longitudinal studies that track towers and stakeholders over extended periods may elucidate the evolution of safety management practices. Even if combining case studies assisted with this issue, the results should still be considered as probable links rather than unambiguous cause-and-effect paths.

6.2 Sampling and RepresentationThe professional sample (N = 200) had enough statistical power to illustrate what engineers, contractors, and regulators in Dubai, Abu Dhabi, and Sharjah thought. But it didn't include Ajman, Fujairah, or Ras Al Khaimah, which are other emirates where the rules can be different. There weren't enough people living there or people who could aid right away. Evacuation rules and emergency limits have an immediate effect on these populations. It would be better to include them in future initiatives because the outcomes would be more valuable and generalizable.

6.3 Measurement versus OutcomesMost of the categories were self-reported, which means that people may not have done what they thought they did. People who answer the question might assume a tower is "safe," yet it could still have alarms that don't work or coatings that are broken. People who haven't seen a tower with a powerful FSMS might not think it's as important on the other hand. Triangulation using case evidence and audit data reduced this bias; however, future studies must include inspection records, drill logs, and sensor telemetry to provide objective performance indicators.

6.4 Climatic and Environmental TestingAnother problem is that there hasn't been any controlled lab testing of degradation thresholds under combined Gulf stresses. The UAE has a unique combination of UV radiation, sand abrasion, and heat cycling that is not included in international standards such as NFPA 285 and BS 8414. If testing doesn't happen rapidly and is specific to the environment, it can be tricky to use results from temperate regimes. To make sure that façade systems, coatings, and adhesives last a long period, it is vital to come up with testing procedures that are similar to Gulf exposure.

6.5 Ethical and Practical ConstraintsIt was challenging to obtain to some event data and compliance audits because of privacy issues and ongoing legal or insurance problems. Some stakeholders were reluctant to disclose operational issues due to concerns about reputation, perhaps leading to outcomes that favored enterprises with better documentation or greater transparency. This

illustrates that we need a single national database that maintains track of all fires, even the little ones and the ones that almost happened. This would enhance empirical coverage while safeguarding individual privacy.

6.6 Ideas for Future Research

Even with these limitations, the research gives us a strong base for better understanding fire safety in difficult situations.

Research should focus on longitudinal assessments of high-rise buildings before and after façade retrofitting.

- To mimic circumstances like those in the Gulf, laboratory tests included sand, UV light, and heat cycling.

- Using AI to find mistakes and see how well things are operating when they do.

Talk to other people, like people who live in your area, insurance companies, and first responders, to gain a larger range of viewpoints.

- Looking at retrofitting programs that started in 2025 to examine how new rules change safety outcomes.

7. Conclusion

7.1 Reiterating the Objective

The principal aim of this study was to analyze the interaction of fire-resistant materials, architectural design and construction laws, and fire safety management systems in safeguarding individuals in high-rise buildings in the UAE during adverse weather circumstances.

The study employed a sequential mixed-methods approach, combining quantitative survey data from 200 specialists with qualitative case studies of significant fire incidents, encompassing both stakeholder viewpoints and direct accounts of occurrences.

7.2 A brief overview of the key findings

The results repeatedly underscore the importance of FSMS.

The regression analysis indicated that FSMS significantly influenced occupant safety (? = 0.625, p < .001), surpassing the impact of material type and design parameters. Association tests corroborated this finding, indicating a significant positive correlation (r = .844, p < .001).

On the other hand, standards for building and designing buildings didn't have much of an effect (? = 0.064, p = 0.18). This indicates that individuals did not consistently adhere to directions.

Fire-resistant materials had a minor but considerable effect (? = 0.196, p = .01).

This highlights the need to use high-quality materials and how quickly these parts break down in the Gulf environment.

7.3 Looking at the case study

The case studies showed how these statistical patterns may be used in real life. The problems at the Torch Tower and Address Downtown highlight how improper maintenance, flammable cladding, and not enough rules may make matters worse. The ADIA Tower case proved that a robust FSMS and adjustments that fit the context can lower hazards and save lives.

These examples show that being strong means more than merely following the rules for design. It also implies that management systems are always up and running and easy to get to.

7.4 Outcomes from Theory

From a theoretical point of view, the research moves forward resilience engineering and socio-technical systems theory. The mediation analysis demonstrates that FSMS serves as a significant connection between technical indicators and safety outcomes.

You need to know the rules and obey them during drills, follow management standards, and work well with others in an emergency. The discussion in global fire safety literature on how the Gulf's climate affects things shows that environmental factors can make compliance devices work less well.

7.5 What the effects on the world mean for policy

The results demonstrate that fire safety standards need to be amended such that testing, third-party audits, and enforcement go beyond just self-certification.

The statement makes it clear that companies can keep their employees and customers safe by obtaining UV-resistant coatings, cleaning up outdated facades, and doing evacuation drills every three months in different conditions.

The document informs lawmakers that they can utilize blockchain to check for compliance, AI to do inspections, and the Internet of Things to keep a watch on everything. All of these things can make things safer and make individuals more responsible.

Economic and Policy DimensionThe findings of this study impact both technical validation and economic and policy considerations.

The global market for fire prevention systems is anticipated to be worth more than $4.1 billion by 2033.

Cities that spend a lot of money on repairing up old buildings and building new ones will grow the fastest.

The UAE is continuously knocking down existing skyscrapers and putting up new ones that are considerably taller.

To safeguard safety, gain insurance, and save money, it's vital to make robust FSMS regulations and specifications that take the weather into account.

Insurance is cheaper for buildings with UV-stable coatings, non-combustible facades, and quarterly evacuation exercises.

These things also make the structures worth more.

7.6 Contributions to Knowledge

This study adds to the body of work on fire safety in three important ways: it shows that FSMS acts as a middleman by showing how management systems affect the accuracy of technology data.

- It looks at how the Gulf environment's stresses affect how materials break down, which haven't been studied before.

- It gives decision-making tools like AI inspections, blockchain compliance, and climate-adapted audits that turn descriptive data into management solutions that can be deployed immediately away.

7.7 Final Reflection

The research indicates that the fire resistance of tall structures in the UAE is influenced by factors outside the materials and building regulations employed. How well they fit into robust and environmentally friendly management systems will determine how effectively they work.

The research contextualizes these results within the UAE's regional framework and the global dialogue on high-rise fire safety, presenting a model for enhanced urban safety in complex environments. The report stresses that good fire safety requires a comprehensive approach that includes modern materials, strict adherence to rules, and flexible management systems that can adapt to changing weather and other factors.

The 11th target of the Sustainable Development Goals is to make cities safe and ready for disasters. This fits with that purpose.

8. References

1- ASTM International. (2020). ASTM E119-20: Standard test methods for fire tests of building construction and materials.

2- ASTM International. (2023). ASTM E84-23: Standard test method for surface burning characteristics of building materials.

3- ASTM International. (2020). ASTM E2307-20: Standard test method for determining fire resistance of perimeter fire barriers using intermediate-scale, multi-story apparatus.

4- BSI. (2020). BS 8414-1:2020 Fire performance of external cladding systems—Part 1: Test method for non-loadbearing external cladding systems fixed to and supported by a masonry substrate.

5- BSI. (2020). BS 8414-2:2020 Fire performance of external cladding systems—Part 2: Test method for non-loadbearing external cladding systems fixed to and supported by a structural steel frame.

6- BSI. (2022). PAS 9980:2022 Fire risk appraisal of external wall construction and cladding of existing blocks of flats—Code of practice.

7- Dubai Civil Defense (DCD). (n.d.). Our Regulations (Fire & Life Safety Code portal).

8- Dubai Civil Defense (DCD). (2023, Aug 21). The UAE Safety Lab undergoes major service transformation starting from 2024.

9- European Commission JRC. (2023). EU-level technical guidance on adapting buildings to climate change.

10- European Commission JRC. (2021). The status and needs for implementation of fire safety in buildings in the EU.

11- FCIA. (2022). Perimeter fire containment—ASTM E2307 overview and testing considerations.

12- Government of the UK. (2022). Building Safety Act 2022.

13- Government of the UK. (2023, Oct 19). Guidance on the criteria for being a higher-risk building.

14- Grenfell Tower Inquiry. (2019). Phase 1 Report.

15- Grenfell Tower Inquiry. (2024). Phase 2 Report.

16- ISO. (2020). ISO 11925-2:2020 Reaction to fire tests—Ignitability of building products subjected to direct impingement of flame—Part 2: Single-flame source test.

17- ISO. (2015). ISO 5660-1:2015 Reaction to fire tests—Heat release rate (cone calorimeter method) and smoke production rate (dynamic measurement)—Part 1.

18- National Fire Protection Association (NFPA). (2024). NFPA 1: Fire Code (2024 ed.).

19- National Fire Protection Association (NFPA). (2024). NFPA 14: Standard for the Installation of Standpipe and Hose Systems (2024 ed.).

20- National Fire Protection Association (NFPA). (2022). NFPA 13: Standard for the Installation of Sprinkler Systems (2022 ed.).

21- National Fire Protection Association (NFPA). (2021). NFPA 92: Standard for Smoke Control Systems (2021 ed.).

22- RICS. (2023). Technical due diligence of commercial property (Professional Standard; reissued Apr 2023).

23- Queensland Government—Housing. (2025, May 20). Managing combustible cladding in Queensland.

24- Queensland Government—Safer Buildings. (n.d.). Safer Buildings (program site).

25- NSW Audit Office. (2022, Apr 13). Building regulation: Combustible external cladding.

26- SFPE (Society of Fire Protection Engineers). (2022). SFPE Handbook of Fire Protection Engineering (6th ed.). Springer.

27- SFPE. (2018). SFPE Guide to Human Behavior in Fire. Springer.

28- USFA/FEMA. (2022, Jan 12). Protecting people who live or work in high-rises.

29- CTIF—Center for Fire Statistics. (2024). World Fire Statistics Report No. 29.

30- UAE Ministry of Interior. (2024). 2023 fire incident statistics (press summary).

31- Dubai Data & Statistics Establishment. (2025). Health & Safety—Civil Defense services datasets.

32- ANSI/Intertek. (2023). Overview of ASTM E84-23 surface burning test (technical note).

33- Intertek. (2020). ASTM E2307 perimeter fire barriers—Scope and application (technical note).

34- NFPA. (2021, Nov 18). Standpipe system design and calculations (NFPA blog; NFPA 14 context).

35- NFSA (National Fire Sprinkler Association). (2024, Oct 22). Updates to NFPA 14 (2024 edition) (Technotes).

36- BSI Group. (2020, Apr 30). BSI revises British Standard test method for the fire performance of external cladding systems (BS 8414 media note).

37- Meacham, B. J. (2022). Fire performance and regulatory considerations with modern methods of construction. Buildings and Cities, 3(1), 194–214.

38- Huang, X., et al. (2023). Special Issue on Façade Flammability and Fire Engineering (Editorial). Fire Technology.

39- Qin, R., Dai, X., Ding, C., Zhang, Z., Jiao, Y., & Ren, X. (2024). A study on the impact of window partition walls on the spread of fire on building facades. Fire, 7(7), 253. https://doi.org/10.3390/fire7070253

40- E Paula, D. J., et al. (2024). Performance fire tests on external walls made of sandwich panels. Fire Safety Journal.

41- Yang, S., et al. (2025). Study on façade flame spread of high-rise buildings under strong wind. Applied Sciences, 15(3), 1327.

42- Tabatabaei, S. S., et al. (2023). Effect of façade materials and coatings on urban heat island in hot semi-arid climate. Building and Environment, 243, 110701.

43- Barrelas, J., et al. (2023). Effects of climate change on rendered façades: Expected degradation in warmer, drier climates—A review. Buildings, 13(8), 1958.

44- Athauda, R. S., et al. (2023). Climate change impacts on façade building materials. Sustainability, 15(10), 7893.

45- Vakhitova, L., et al. (2024). Improving the fire-retardant performance of industrial intumescent coatings: A review. Heliyon, 10, e10760.

46- Häßler, D., et al. (2024). Durability of intumescent coatings and recommendations for long-life test concepts. Fire Safety Journal.

47- Beraldo, C. H. M., et al. (2020). Fire protection of ultraviolet-aged intumescent coatings. Progress in Organic Coatings, 149, 105972.

48- Fürst, R., et al. (2025). Fire resistance of steel structures with aged intumescent coatings. Fire Safety Journal.

49- Piperopoulos, E., et al. (2025). Durability assessment of eco-friendly intumescent coatings with cork and waste-glass fillers. Polymers, 17(12), 1659.

50- Patel, R., et al. (2025). Fire-resistant coatings: Advances in flame-retardant systems—A review. Coatings.

51- Ali, M., et al. (2025). Advanced sensor technologies for early fire detection and IoT integration—A review. Chemosensors, 13(7), 230.

52- AlQahtani, A. A. S., et al. (2025). IoT in fire detection, localization and evacuation: A comprehensive review and bibliometric analysis. Sensors, 25(2), 41.

53- Shaharuddin, S., et al. (2023). The role of IoT sensors for indoor fire hazard scenarios in smart buildings: A systematic review. Internet of Things, 22, 100803.

53- International Fire & Safety Journal. (2024, Dec 18). European Commission validates harmonised façade fire-testing methodology.

54- Financial Times. (2024, Dec 2). UK sets new deadlines to fix unsafe cladding on tall buildings by 2029.